

1SAW2: (非标)

箱体中心距地1.5M挂墙明装

$P_e=55kW$
 $K_x=1.0$
 $COS\phi=0.8$
 $P=55kW$
 $I_{js}=104.5A$


WDZ-YJE-0.6KV-4X50+1X25 SC65 WC
小区公变引来

至电气火灾监控主机

HS-L8C01T

LM-0.38
200/5

Wh
DT862
3(6)A

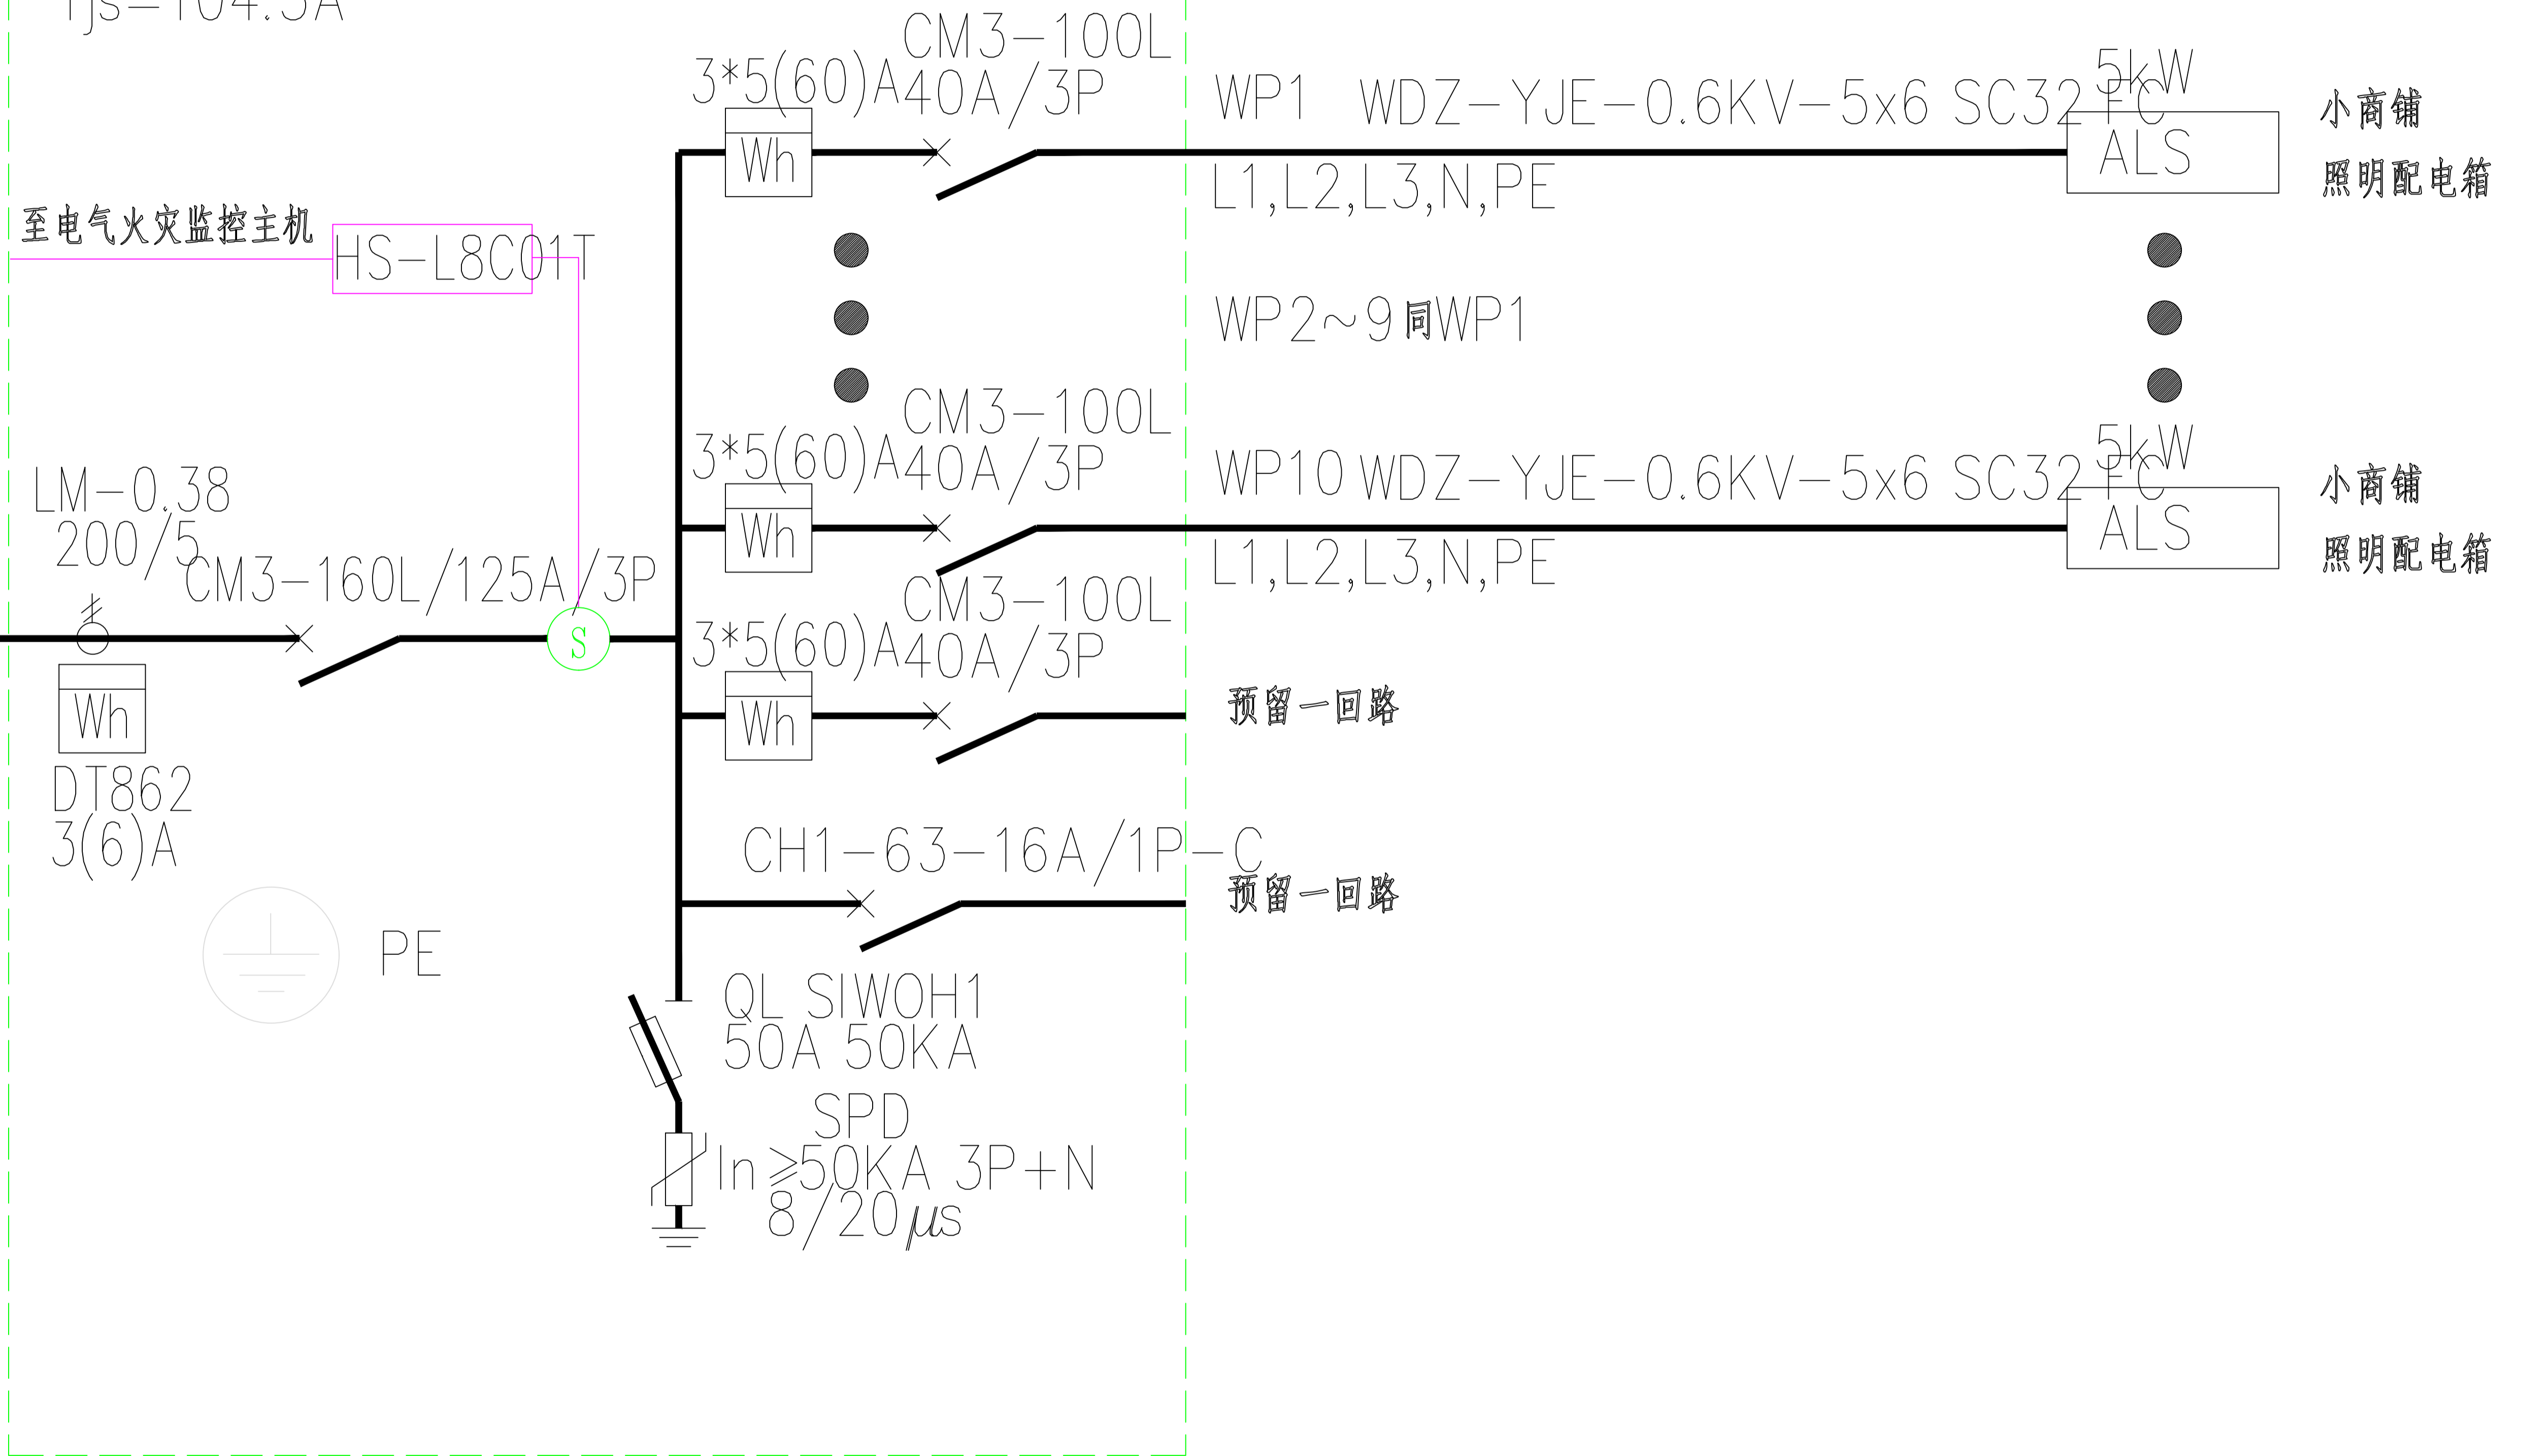

1#楼商铺电表箱系统图2

WDZ-YJE-0.6KV-4X70+1X35 SC80 WC
小区公变引来

1SAW3: (非标)

箱体中心距地1.5M挂墙明装

Pe=95kW
Kx=0.8
COSφ=0.8
P=76kW
Ijs=144.4A

至电气火灾监控主机

HS-L8C01T

LM-0.38
200/5

Wh
DT862
3(6)A



CM3-250L/160A/3P


CM3-100L
3*5(60)A40A/3P




CM3-100L
3*5(60)A40A/3P



CM3-100L
3*5(60)A40A/3P




CM3-100L
3*5(60)A40A/3P




CM3-100L
3*5(60)A40A/3P



CH1-63-16A/1P-C

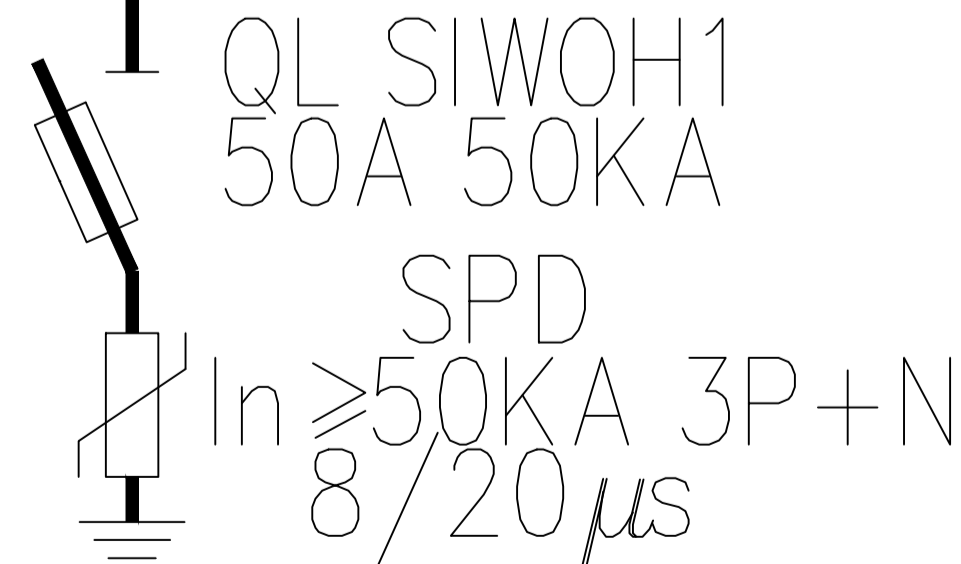


WP1 WDZ-YJE-0.6KV-5x6 SC32
L1,L2,L3,N,PE

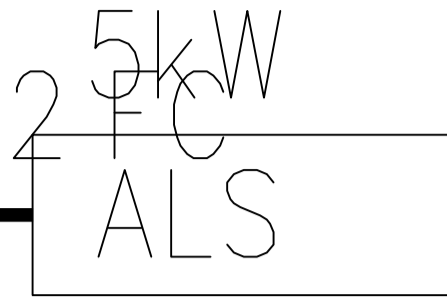

小商铺
照明配电箱

WP2~8同WP1

WP9 WDZ-YJE-0.6KV-5x6 SC32
L1,L2,L3,N,PE

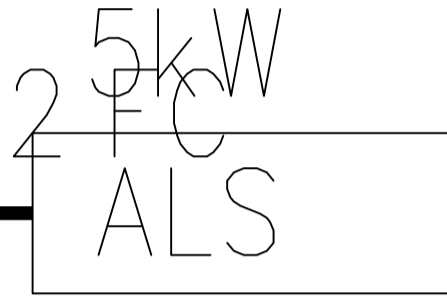

小商铺
照明配电箱


WP10 WDZ-YJE-0.6KV-5x6 SC32
L1,L2,L3,N,PE



大商铺
照明配电箱

WP11~12同WP10

WP14 WDZ-YJE-0.6KV-5x6 SC32
L1,L2,L3,N,PE

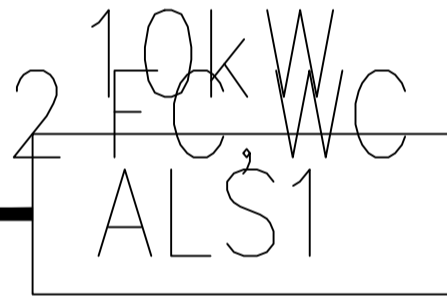


大商铺
照明配电箱

预留一回路

预留一回路

2#楼商铺电表箱系统图1

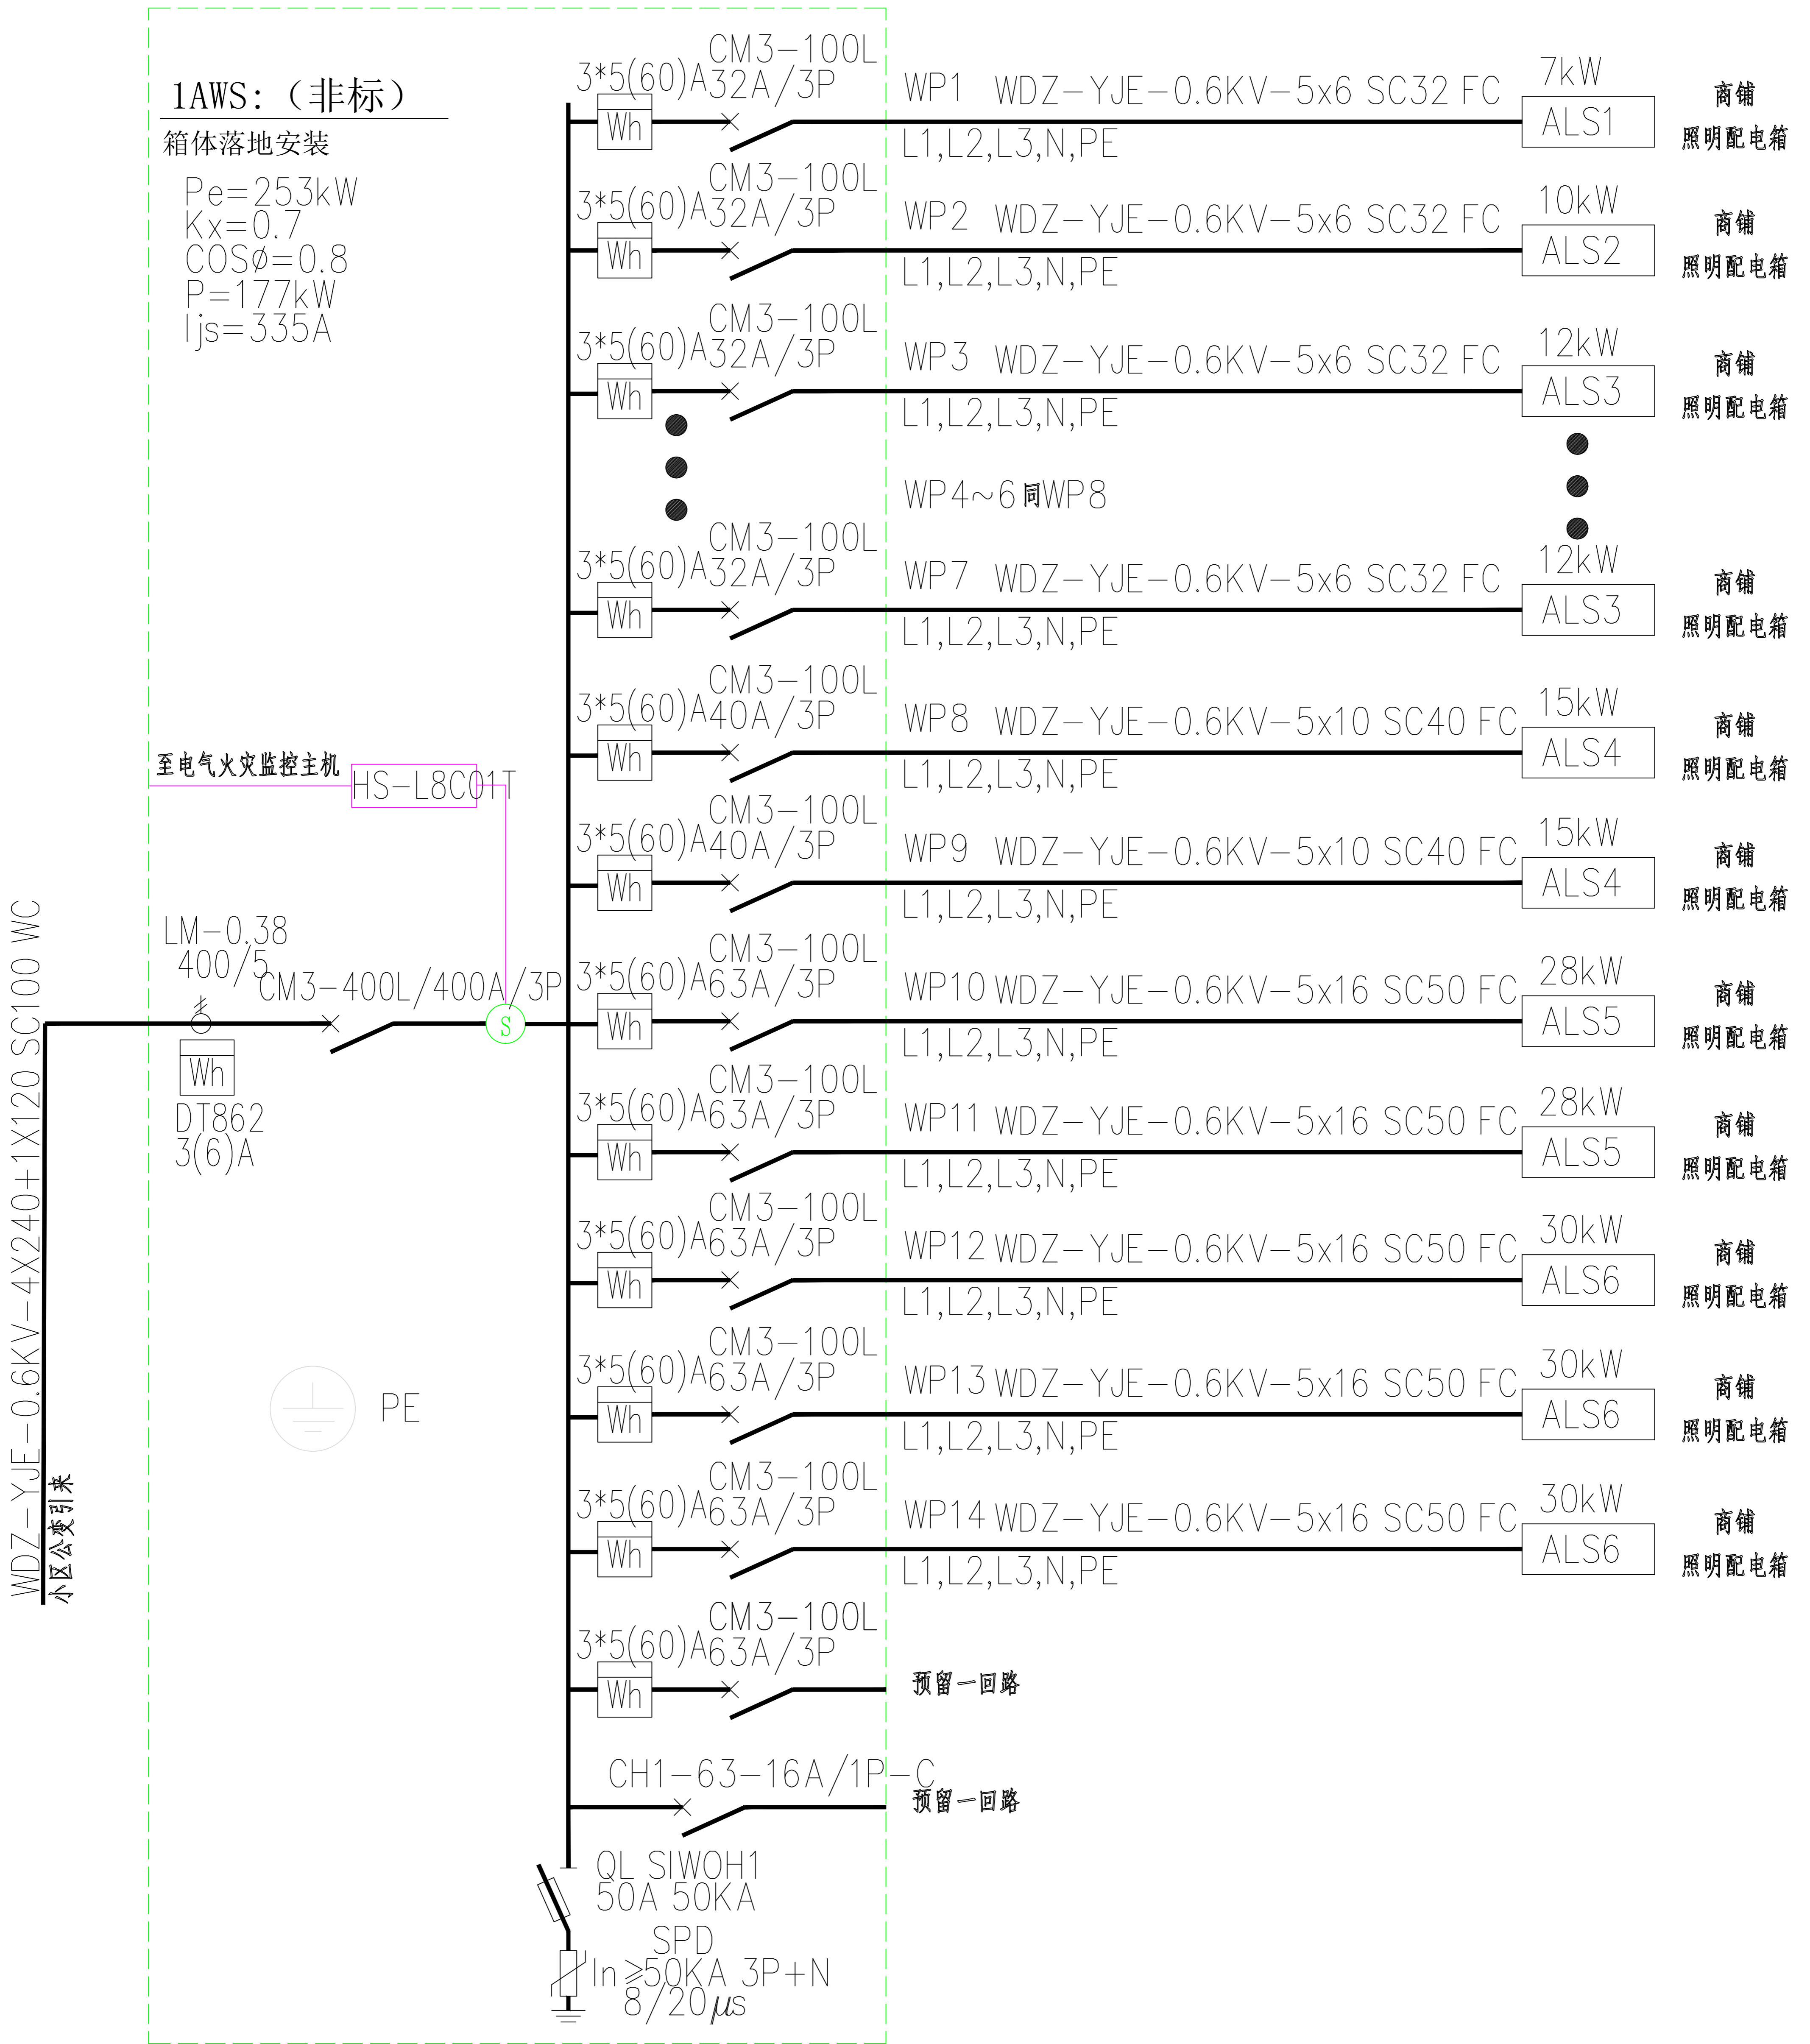

3#、4#楼商铺电表箱系统图1

1AWS: (非标)

箱体落地安装

Pe=243kW
Kx=0.7
COSφ=0.8
P=170kW
Ijs=322A

至电气火灾监控主机

HS-L8C01T

LM-0.38
400/5

CM3-400L/400A/3P

Wh
DT862
3(6)A

PE

CM3-100L
3*5(60)A32A/3P

Wh

WP1 WDJ-YJE-0.6KV-5x6 SC32 FC
L1,L2,L3,N,PE

5kW
ALS0

商铺
照明配电箱

CM3-100L
3*5(60)A32A/3P

Wh

WP2 WDJ-YJE-0.6KV-5x6 SC32 FC
L1,L2,L3,N,PE

7kW
ALS1

商铺
照明配电箱

CM3-100L
3*5(60)A32A/3P

Wh

WP3 WDJ-YJE-0.6KV-5x6 SC32 FC
L1,L2,L3,N,PE

10kW
ALS2

商铺
照明配电箱

CM3-100L
3*5(60)A32A/3P

Wh

WP4 WDJ-YJE-0.6KV-5x6 SC32 FC
L1,L2,L3,N,PE

12kW
ALS3

商铺
照明配电箱

CM3-100L
3*5(60)A32A/3P

Wh

WP5 WDJ-YJE-0.6KV-5x6 SC32 FC
L1,L2,L3,N,PE

12kW
ALS3

商铺
照明配电箱

CM3-100L
3*5(60)A32A/3P

Wh

WP6 WDJ-YJE-0.6KV-5x6 SC32 FC
L1,L2,L3,N,PE

12kW
ALS3

商铺
照明配电箱

CM3-100L
3*5(60)A32A/3P

Wh

WP7 WDJ-YJE-0.6KV-5x6 SC32 FC
L1,L2,L3,N,PE

12kW
ALS3

商铺
照明配电箱

CM3-100L
3*5(60)A40A/3P

Wh

WP8 WDJ-YJE-0.6KV-5x10 SC40 FC
L1,L2,L3,N,PE

15kW
ALS4

商铺
照明配电箱

CM3-100L
3*5(60)A50A/3P

Wh

WP9 WDJ-YJE-0.6KV-5x16 SC50 FC
L1,L2,L3,N,PE

24kW
ALS5

商铺
照明配电箱

CM3-100L
3*5(60)A50A/3P

Wh

WP10 WDJ-YJE-0.6KV-5x16 SC50 FC
L1,L2,L3,N,PE

24kW
ALS5

商铺
照明配电箱

CM3-100L
3*5(60)A50A/3P

Wh

WP11 WDJ-YJE-0.6KV-5x16 SC50 FC
L1,L2,L3,N,PE

24kW
ALS5

商铺
照明配电箱

CM3-100L
3*5(60)A63A/3P

Wh

WP12 WDJ-YJE-0.6KV-5x16 SC50 FC
L1,L2,L3,N,PE

28kW
ALS6

商铺
照明配电箱

CM3-100L
3*5(60)A63A/3P

Wh

WP13 WDJ-YJE-0.6KV-5x16 SC50 FC
L1,L2,L3,N,PE

28kW
ALS6

商铺
照明配电箱

CM3-100L
3*5(60)A63A/3P

Wh

WP14 WDJ-YJE-0.6KV-5x16 SC50 FC
L1,L2,L3,N,PE

30kW
ALS7

商铺
照明配电箱

CM3-100L
3*5(60)A40A/3P

Wh

预留一回路

CH1-63-16A/1P-C

预留一回路

QL SIWOH1
50A 50KA

SPD
In ≥ 50KA 3P+N
8/20μs

WDZ-YJE-0.6KV-4X240+1X120 SC100 WC
小区公变引来

5#、6#楼商铺电表箱系统图1